


NOTES

1. Manhole Steps Shall Be M.A. Industries Model PS-1 Or Equal.
2. 1" Copper Tubing Shall Be Type K Firmly Anchored To The Manhole Walls And Ceiling.
3. Meter Yoke Shall Be Ford Y502 Assembly w/Angle Valves
4. Angle Valves Shall Be Ford KV43-342W, Teflon Coated
5. 12" And Smaller WaterMains Shall Have Gate Valves, Larger Than 12" Shall Have Butterfly Valves.

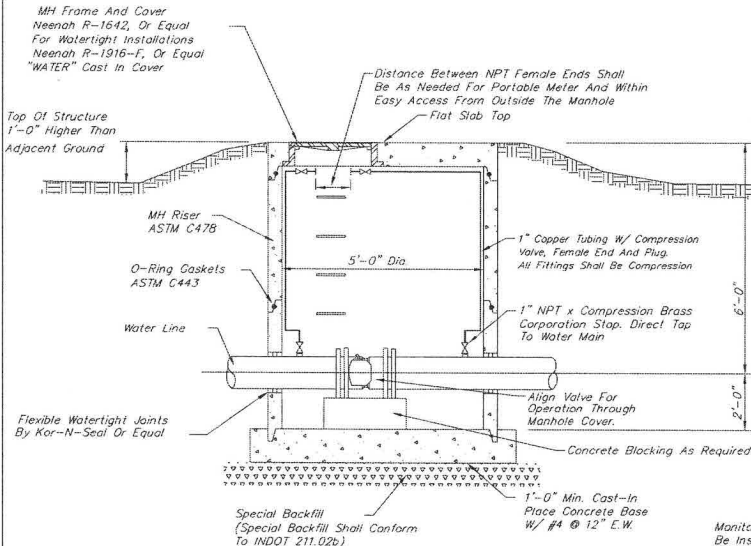

Monitoring Manholes Shall
Be Installed At
Each Stream Crossing

CITY OF CARMEL STANDARD DETAILS		TITLE: MONITORING MANHOLE	
Date: March 2001	Scale: Not To Scale	Drawn By: Jones & Henry Engineers, Inc.	Drawing Name: CW6