


Manhole Frame and Cover
 Heavy Duty: Neenah R-1642A or Equal
 Watertight: Neenah R-1916-F or Equal

Watertight Flexible Boots Must
 Be Used At All Openings

Concrete Adjusting Rings
 Limited to (3) Rings.
 Maximum Combined Height
 of 12". Rings Must be Butyl
 Rubber Coated With Plastic Wrap
 Cover.

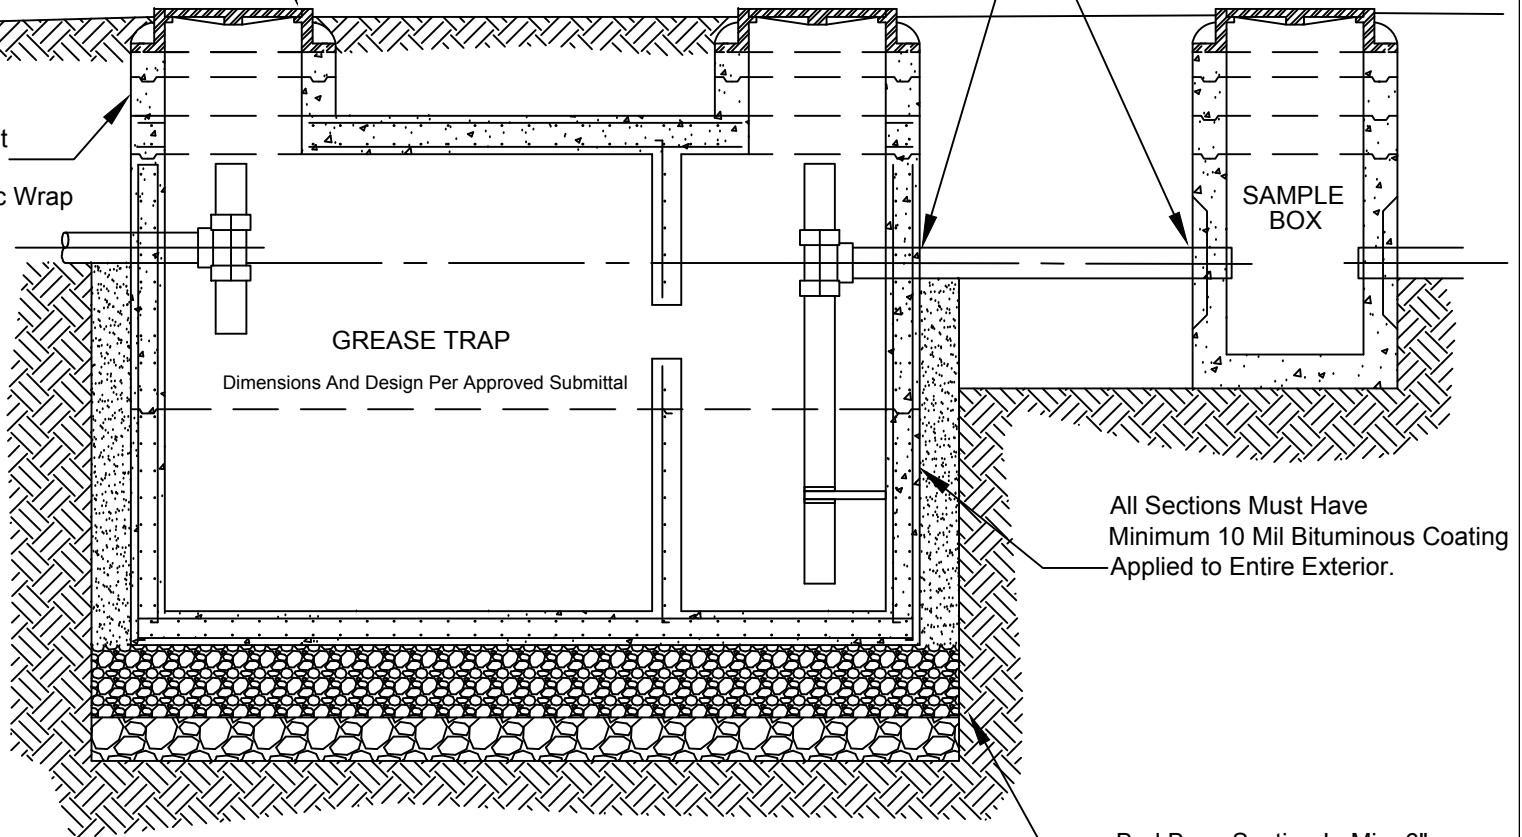

GREASE TRAP

Dimensions And Design Per Approved Submittal

SAMPLE
 BOX

All Sections Must Have
 Minimum 10 Mil Bituminous Coating
 Applied to Entire Exterior.

Bed Base Section In Min. 6"
 Compacted #8 Granular Material

NOTES

All Grease Traps Must Be Sized According To
 The Indiana State Department Of Health Bulletin S.E.1.3
 The Sizing Method Must Be Approved By The City.

Shop Drawings Must Be Submitted To The Utility
 For Approval.

Grease Trap and Sample Box Are Property Of Owner
 And Will Not Be Maintained By The Utility.

City of Carmel Utilities
 Standard Details

Title: GREASE TRAP AND
 SAMPLE BOX

Date: January 2016	Scale: Not To Scale	Drawing: CS 30	Page 15
--------------------	---------------------	----------------	---------