


NOTES:

1. FOR USE ONLY IN LANDSCAPED SURFACES WITHIN THREE FEET OF BUILDING.

2. ALL SLAB AND CRAWL SPACE CONNECTIONS MUST BE A MINIMUM OF 3" BELOW THE FOOTER AND EXIT THE BUILDING AT THE FRONT OF THE STRUCTURE TO PROVIDE THE SHORTEST, MOST DIRECT ROUTE FROM THE BUILDING TO THE EXISTING LATERAL STUB.

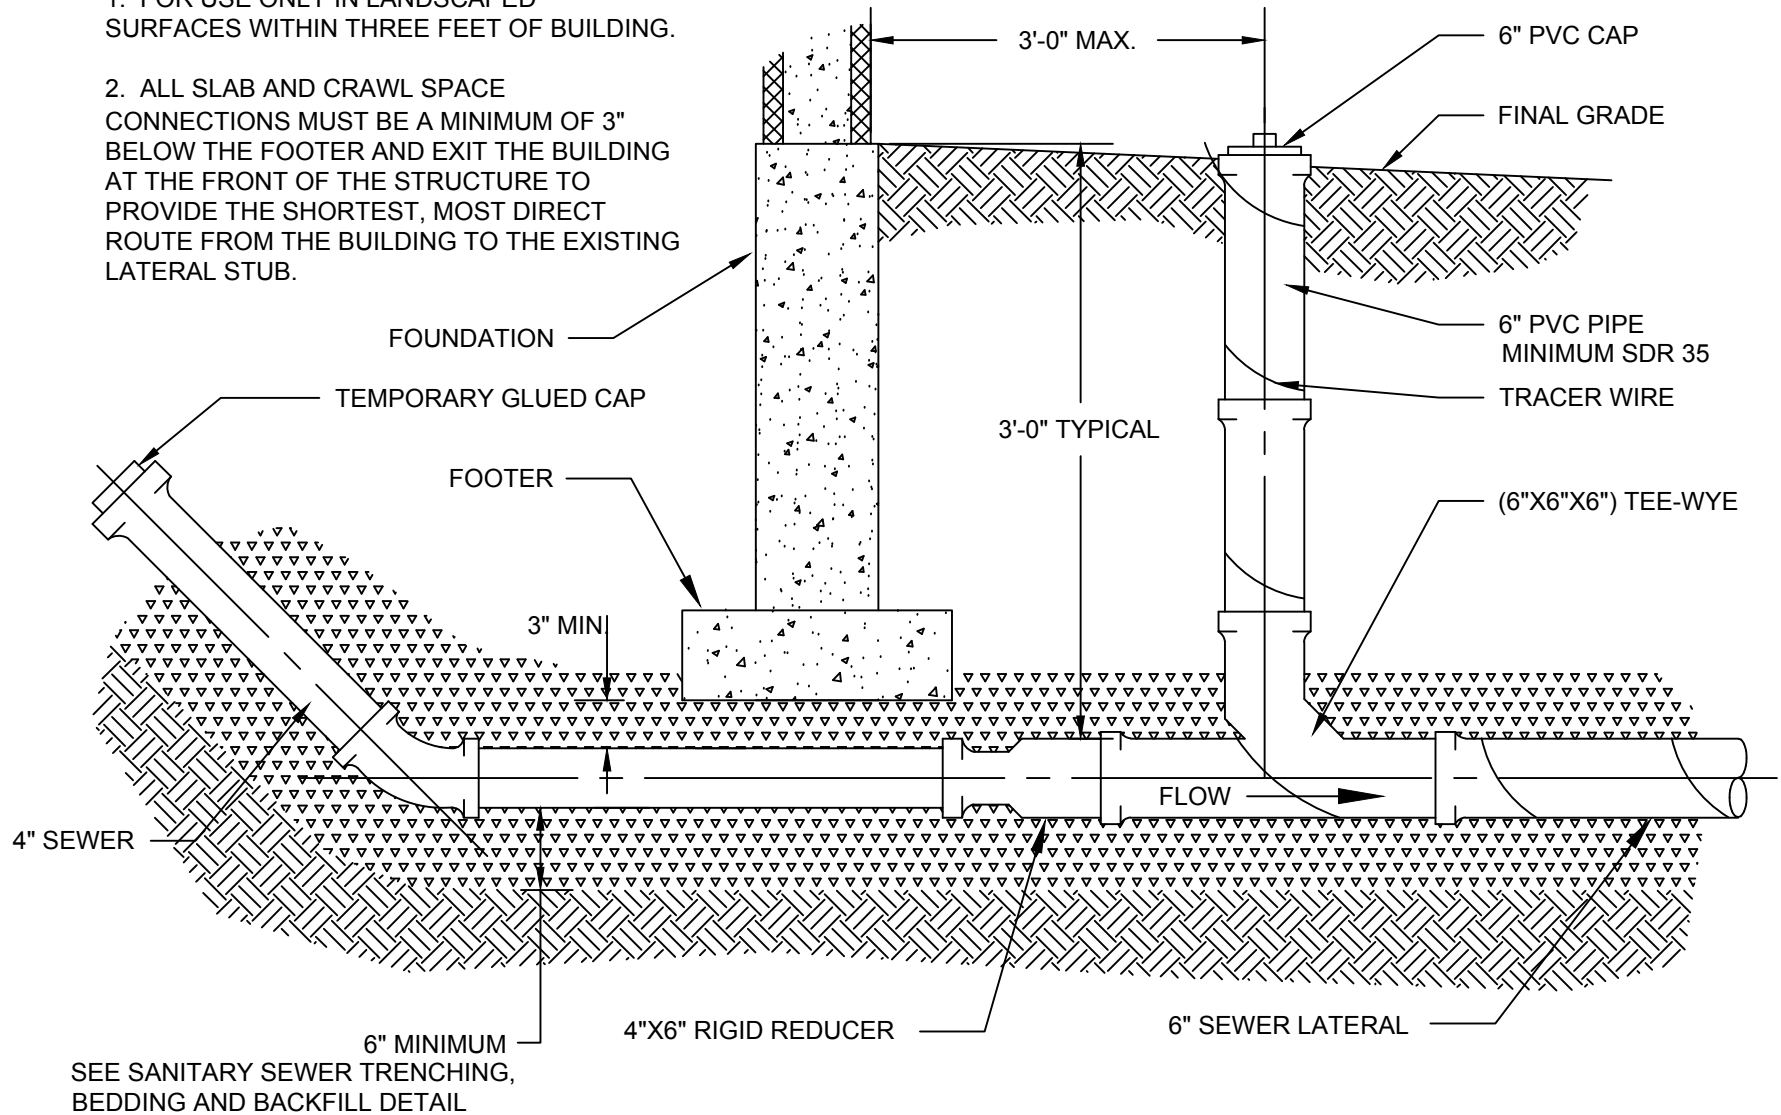

6" MINIMUM
SEE SANITARY SEWER TRENCHING,
BEDDING AND BACKFILL DETAIL

City of Carmel Utilities Standard Details		Title: TYPE I CLEANOUT DETAIL	
Date: January 2016	Scale: Not To Scale	Drawing: CS 18	Page 27